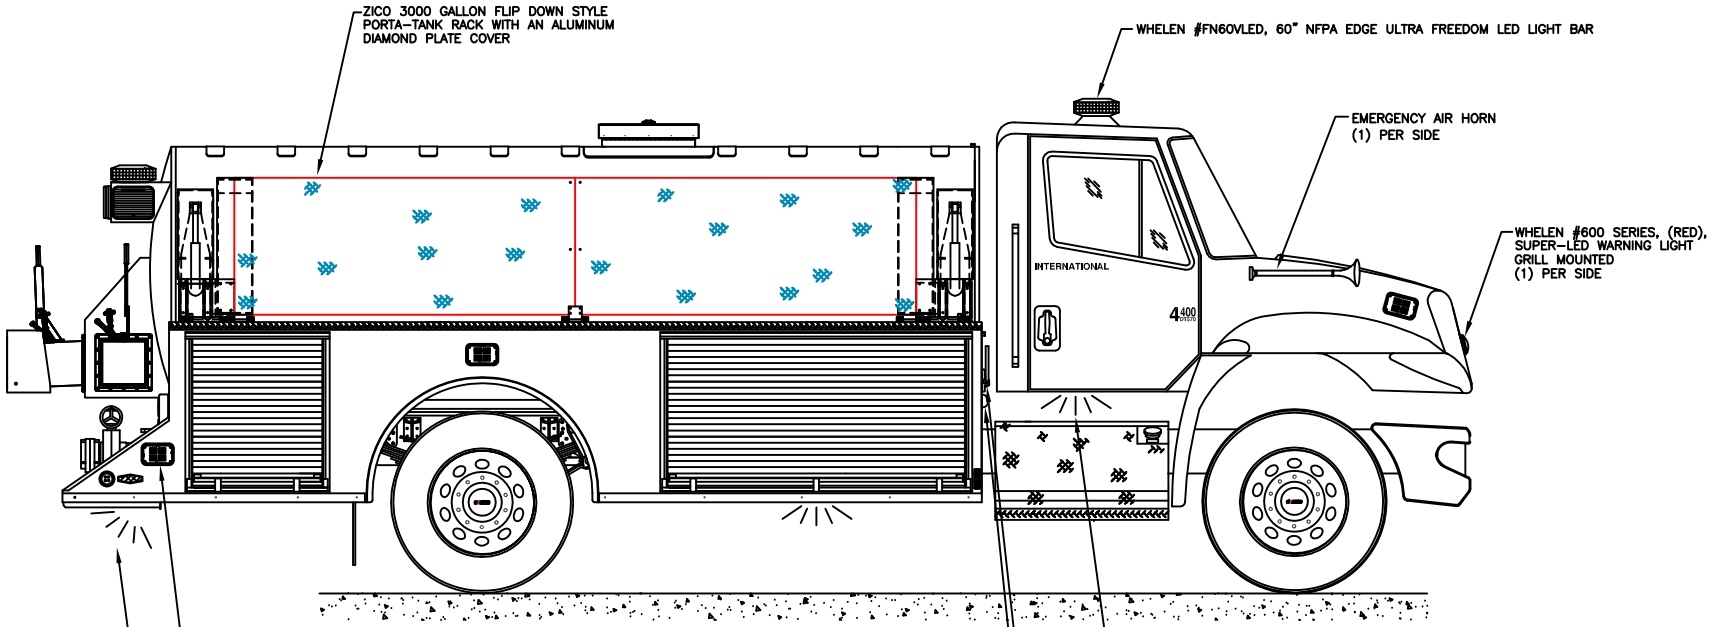

CUSTOMER APPROVAL
THIS DRAWING IS ONLY A REPRESENTATION OF THE PRODUCT. EXACT LOCATION OF COMPONENTS MAY DIFFER DUE TO MANUFACTURING/SUPPLIER CHANGE. WRITTEN SPECIFICATIONS SUPERSEDE PRINTS
SIGNATURE _____
TITLE _____
DATE _____
CONCEPT ☐ ORDER ☐
BID ☒ UST#XXXX

CUSTOMER	PLATO FIRE DEPT.		
SIZE	2000 GALLON		
TANK MATERIAL	POLYPROPYLENE COPOLYMER		
BODY MATERIAL	STAINLESS STEEL		
CROSS SECTION	53" X 75" X 180"LG		
AFTERFRAME	70"		
PUMP	DARLEY HM 500 GPM (PTO)		
CHASSIS	INTERNATIONAL 4400 SERIES		
DRAWN BY	JLB	DATE	2/11/11

ALL DIMENSIONS ARE FOR REFERENCE ONLY

USTANKER FIRE APPARATUS

1827 HOBBS DR.
DELAVAN, WI. 53115
PHONE: 1-(800)-279-4911
FAX: 1-(262)-725-7000
E-MAIL SALES@USTANKER.COM
WEBSITE: WWW.USTANKER.COM

SCALE: 1/30	SHEET: 3 OF 3	REV#: 6/13/11